

# Fenwal Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

Pressure Operated Switch Data Sheet

F-44-5180




A UTC Fire & Security Company

P/N: 81-486536-000

## FEATURES

- For use with UL Listed, ULC Listed, and FM Approved Systems

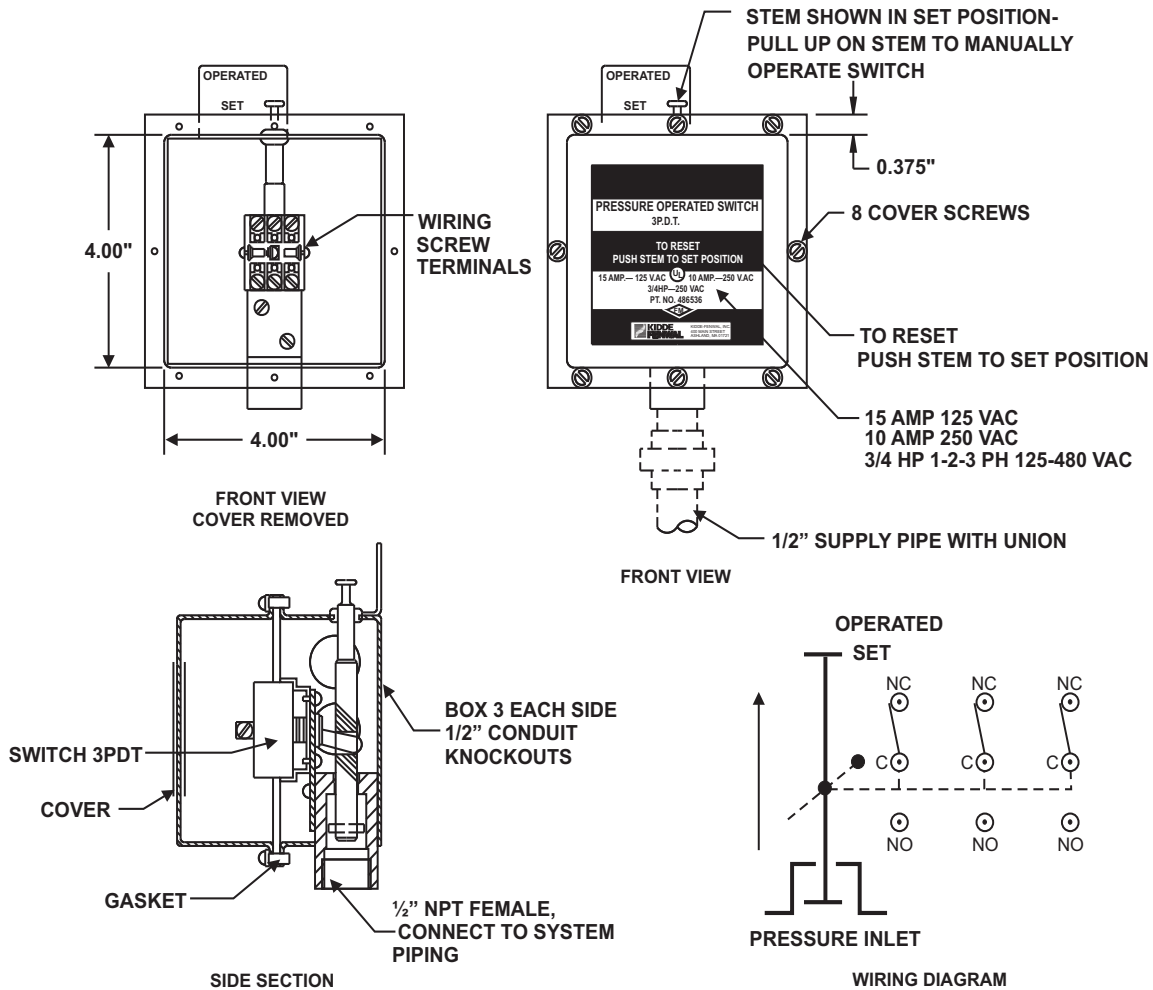

## NOTES

- The switch may be mounted in any position, however, the preferred installation is upright, as shown.
- Any load connection to the switch must not exceed the switch rating, and shall utilize a suitable protection device (i.e., circuit breaker, fuse).
- Contact Ratings (3 PDT)
  - 15 Amp @ 125 Vac
  - 10 Amp @ 250 Vac
  - 3/4 HP @ 250 Vac
  - 1, 2, or 3 Phase

Fenwal is a registered trademark of Kidde-Fenwal, Inc.  
 3M and Novec are trademarks of 3M.  
 All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.

If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Fenwal Protection Systems  
 A UTC Fire & Security Company  
 400 Main Street  
 Ashland, MA 01721  
 Ph: 508.881.2000  
 Fax: 508.881.8920  
[www.fenwalfire.com](http://www.fenwalfire.com)